

METER BOX

IN PAVED AREAS

CUL-DE-SAC (DEAD-END): FOG-TITE J-20S



THRU-STREET SHOULDER: FOG-TITE J-20S
W/LOCKING LID

TRAVELED STREET LANE: 20 1/4" DIAMETER CAST IRON
MANHOLE COVER FOR 18"
OPENING FRAME (EQUAL TO
OLYMPIC FOUNDRY MH12SP
COVER WITH MH12A FRAME)
TO READ "WATER", WITH
RAISED NON-SKID PATTERN
RATED FOR H-20 LOAD.
FRAME SHALL BE 4" DEEP,
SET WITH FLANGE-SIDE DOWN
IN 12" DEEP BY 9" WIDE
PERIMETER OF 3000 PSI
CEMENT CONCRETE.

OUTSIDE PAVED AREAS

(NOT SUBJECT TO TRAFFIC
LOAD)

FOG-TITE B-10T

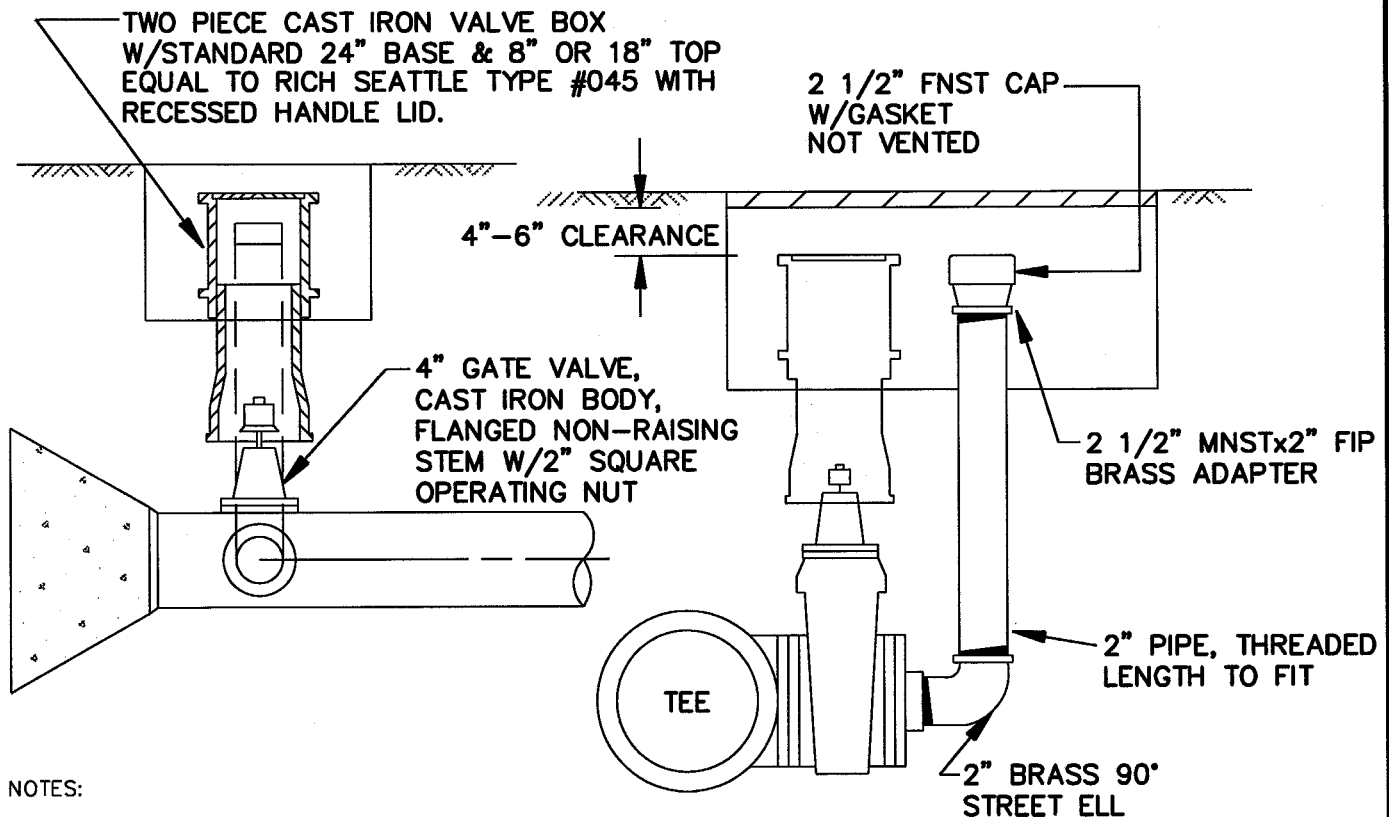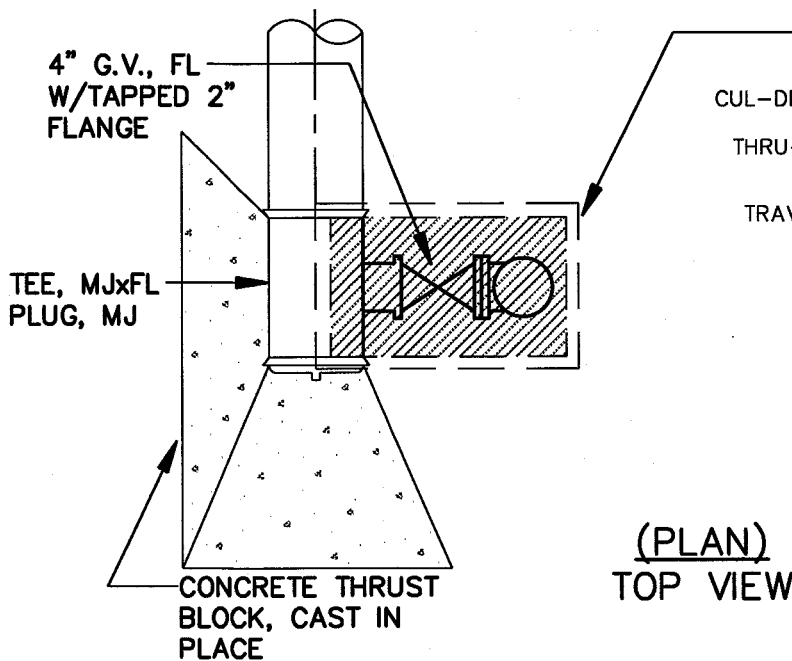

NOTES:

1. ALL PIPE SHALL BE BRASS BEYOND GATE VALVE.
2. ALL ASSEMBLIES SHALL BE LOCATED IN STREET UNLESS OTHERWISE NOTED.
3. WHEN INSTALLED OUTSIDE PAVED AREAS, INSTALL VALVE MARKER POST PER STANDARD DETAIL NO. W-13 AND FIELD LOCATE ADJACENT TO METER BOX PAINTED WITH TWO COATS OF RUSTOLEUM HIGH GLOSS WHITE PAINT.



**City of
Bellevue**

WATER UTILITIES

TITLE

2" BLOW-OFF ASSEMBLY

FEBRUARY 28, 1996

NO SCALE

NO. W-14